

# CERTIFICATE OF CONFORMITY

## 1. HAZARDOUS (CLASSIFIED) LOCATION ELECTRICAL EQUIPMENT PER US REQUIREMENTS

2. **Certificate No:** FM25US0220X
3. **Equipment:** F101-P \*, F102-P\*, and F104-P\* Fieldbus Power Supply Modules.  
(Type Reference and Name)
4. **Name of Listing Company:** Relcom Inc
5. **Address of Listing Company:** 2221 Yew St, Forest Grove, Oregon 97116, United States of America
6. The examination and test results are recorded in confidential report number:

3035979 dated 6<sup>th</sup> July 2010

7. FM Approvals LLC, certifies that the equipment described has been found to comply with the following Approval standards and other documents:

FM 3600:2022, FM 3611:2021, FM 3810:2021

8. If the sign 'X' is placed after the certificate number, it indicates that the equipment is subject to specific conditions of use specified in the schedule to this certificate.
9. This certificate relates to the design, examination and testing of the products specified herein. The FM Approvals surveillance audit program has further determined that the manufacturing processes and quality control procedures in place are satisfactory to manufacture the product as examined, tested and Approved.

## 10. Equipment Ratings:

Nonincendive for use in Class I, Division 2, Groups A, B, C and D; and Class I, Zone 2 IIC hazardous (classified) locations; Temperature Class is T4 Ta = -40°C to +65°C and  $-40^{\circ}\text{C} \leq \text{Tamb} \leq 70^{\circ}\text{C}$  (load  $\leq 400\text{mA}$ )

## Certificate issued by:



J.E. Marquedant  
VP, Manager - Electrical Systems

7 August 2025

Date

To verify the availability of the Approved product, please refer to [www.approvalguide.com](http://www.approvalguide.com)

**THIS CERTIFICATE MAY ONLY BE REPRODUCED IN ITS ENTIRETY AND WITHOUT CHANGE**

FM Approvals LLC. One Technology Way, Norwood, MA 02062 USA

T: +1 (1) 781 762 4300 F: +1 (1) 781 762 9375 E-mail: [information@fmapprovals.com](mailto:information@fmapprovals.com) [www.fmapprovals.com](http://www.fmapprovals.com)

F 347 (Jul 24)



## SCHEDULE

US Certificate of Conformity No: FM25US0220X

11. The marking of the equipment shall include:

FM250220X  
Class 1 Div 2 ABCD T4  
Class I Zone 2 IIC T4  
-40°C ≤ Tamb ≤ 70°C (load ≤ 400mA)  
-40°C ≤ Tamb ≤ 65°C

12. **Description of Equipment:**

**Electrical Ratings:**

Model No.	Input Voltage	Output Voltage	Output Current
F101	19.2-30VDC	21.5-24VDC	0-500mA
F102	19.2-30VDC	27.8-30VDC	0-500mA
F103	10-30VDC	13-14VDC	0-250mA

**Model Codes:**

**F101-P \***, Fieldbus Power Supply Module.

**F102-P \***, Fieldbus Power Supply Module.

**F104-P \***, Fieldbus Power Supply Module.

\* = S (Pluggable Screw Terminal Connectors) C = (Pluggable Spring Clamp Connectors)

13. **Specific Conditions of Use:**

1. The F10x Fieldbus Power Supply Modules must be installed in a final equipment enclosure in compliance with, mounting, spacing and segregation requirements of the ultimate application, including the use of a tool secured cover.
2. When installed in hazardous locations a warning label must be prominently affixed near the unit(s) which warns the equipment must not be disconnected unless the area is known to be non-hazardous.

14. **Test and Assessment Procedure and Conditions:**

This Certificate has been issued in accordance with FM Approvals US Certification Requirements.

15. **Schedule Drawings**

A copy of the technical documentation has been kept by FM Approvals.

16. **Certificate History**

To verify the availability of the Approved product, please refer to [www.approvalguide.com](http://www.approvalguide.com)

**THIS CERTIFICATE MAY ONLY BE REPRODUCED IN ITS ENTIRETY AND WITHOUT CHANGE**

FM Approvals LLC. One Technology Way, Norwood, MA 02062 USA

T: +1 (1) 781 762 4300 F: +1 (1) 781 762 9375 E-mail: [information@fmapprovals.com](mailto:information@fmapprovals.com) [www.fmapprovals.com](http://www.fmapprovals.com)

F 347 (Jul 24)




## SCHEDULE

US Certificate of Conformity No: FM25US0220X

Details of the supplements to this certificate are described below:

Date	Description
6 July 2010	Original Issue. 3035979
12 March 2013	<u>Supplement 1:</u> Report Reference: 130305 dated March 12 2013. Description of the Change(s): US and Canadian listing updated. Added alternative temp range to 70°C
7 August 2025	<u>Supplement 2:</u> Report Reference: RR246938 dated 7 August 2025. Description of the Change(s): Gap Analysis performed and updated certificate

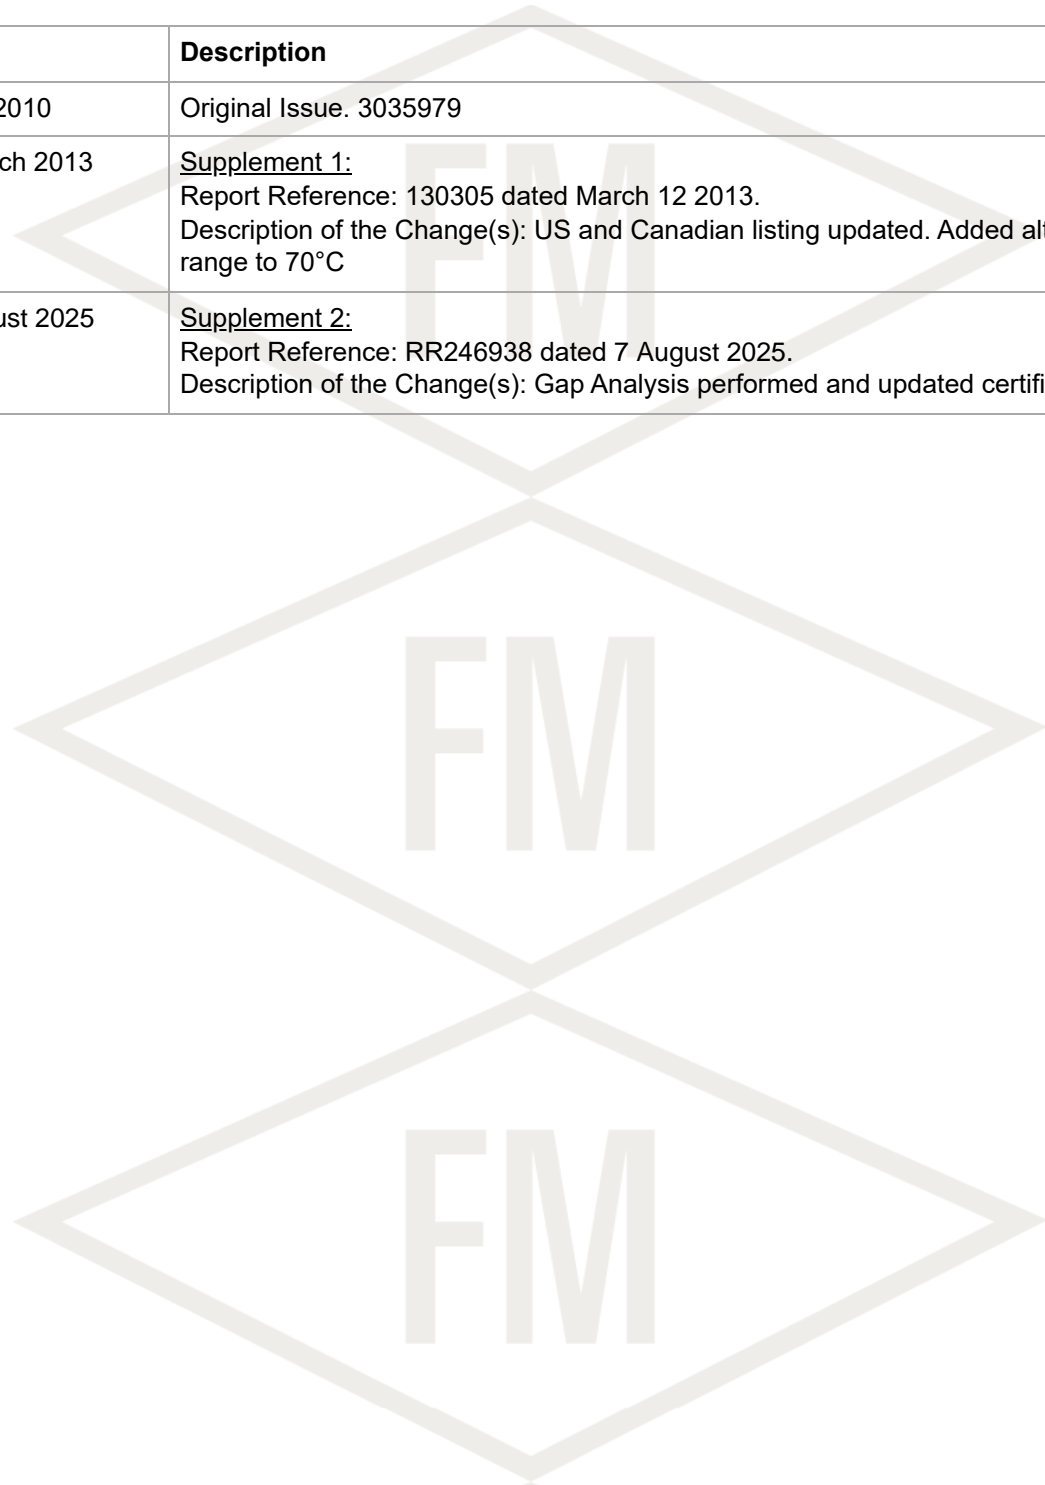

To verify the availability of the Approved product, please refer to [www.approvalguide.com](http://www.approvalguide.com)

**THIS CERTIFICATE MAY ONLY BE REPRODUCED IN ITS ENTIRETY AND WITHOUT CHANGE**

FM Approvals LLC. One Technology Way, Norwood, MA 02062 USA

T: +1 (1) 781 762 4300 F: +1 (1) 781 762 9375 E-mail: [information@fmapprovals.com](mailto:information@fmapprovals.com) [www.fmapprovals.com](http://www.fmapprovals.com)

F 347 (Jul 24)

